
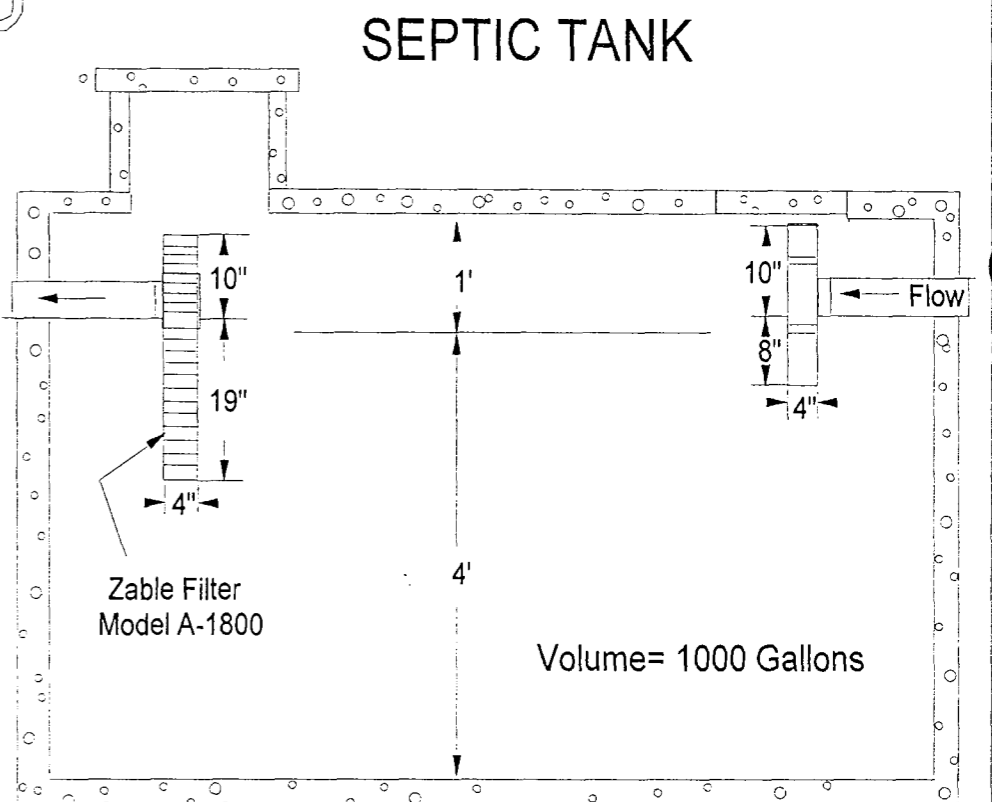
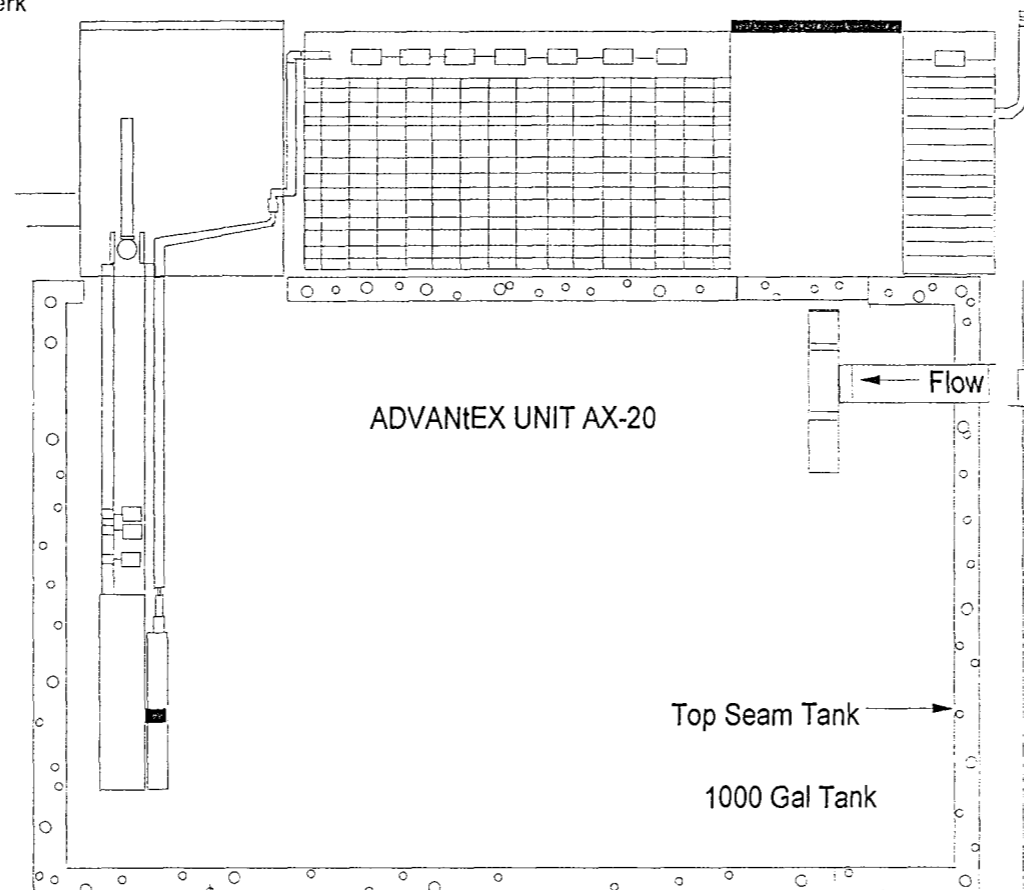




030020508

Betsy B. Woolridge Clerk

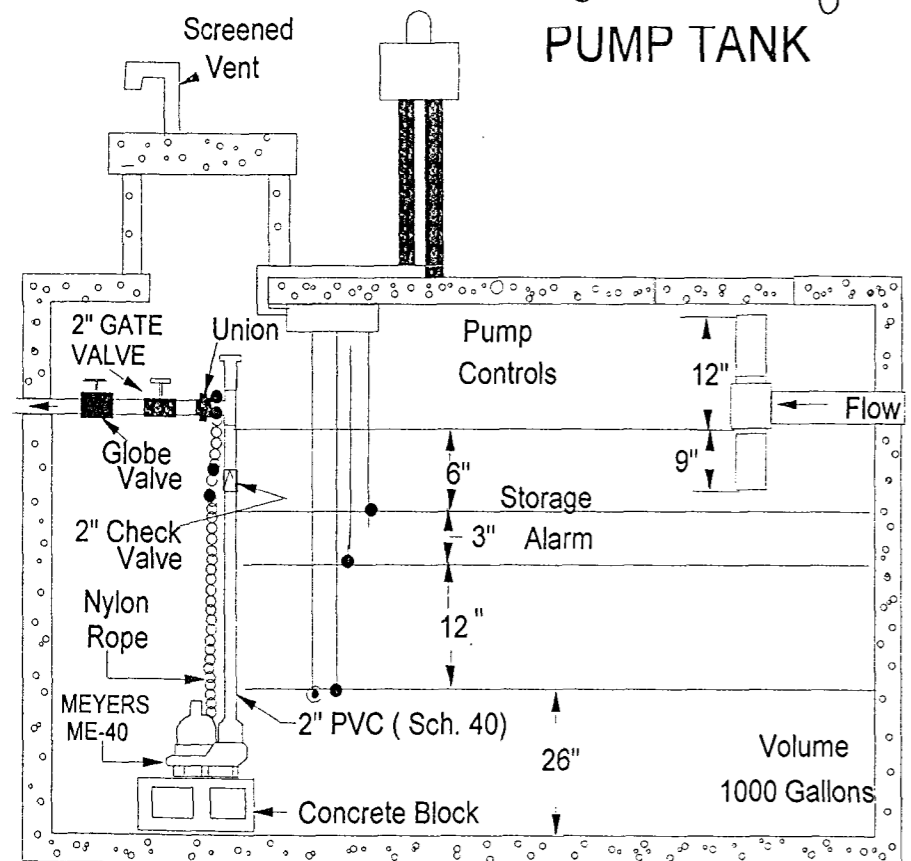

90 PAGE 83

SIMPLEX PANEL TO BE INSTALLED IN A NEMA 4 ENCLOSURE OR EQUAL). PUMP CONTROLS TO BE: AMERICAM MANUFACTURING CO. INC MODEL SEQA4 WITH OVERRIDE FLOAT (OR EQUIVALENT. TIMER SET TO RUN PUMP 60 SECONDS EVERY 96 MIN. (30 GPM X 15 = 450 GPD). GLOBE VALVE SHOULD BE SET TO ALLOW 30 GAL PER MIN.

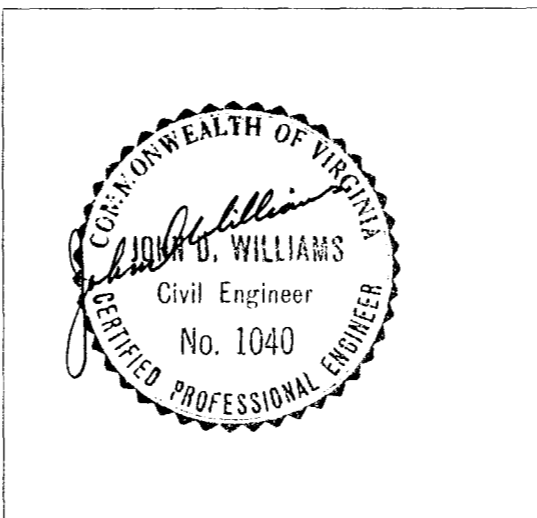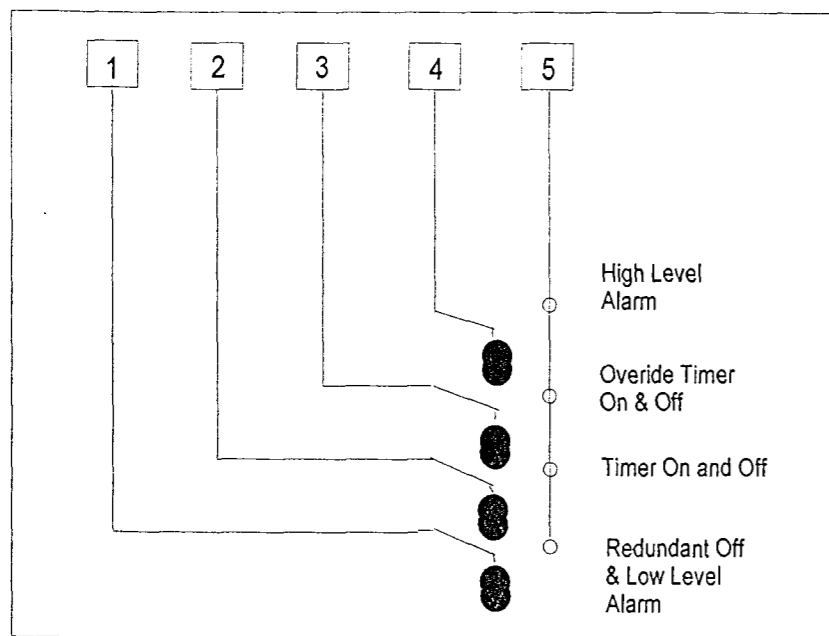

PROPOSED SEWAGE DISPOSAL SYSTEM
 FOR
OAKWOOD HOMES

TAX MAP # 21-4 (2-15)
 COUNTY— JAMES CITY COUNTY
 SCALE- N.T.S.
 DATE- MAY 23, 2003
 PAGE 3 OF 4
 DRAWING NUMBER 03-W61

prepared by:
 William J. Meagher, C.P.S.S.
 Post Office Box 950
 Main Street
 Mathews, Virginia 23109

under the direction of:
 John D. Williams, P.E.
 4307 Coventry, Road
 Richmond, Virginia 23221

804-725-7348